


PRECAST LIGHT POLE BASES




PLAN VIEW

CHAMFER AROUND TOP

ANCHOR BOLTS

PVC CONDUIT AS REQUIRED

#3 REBAR TIES AS REQUIRED

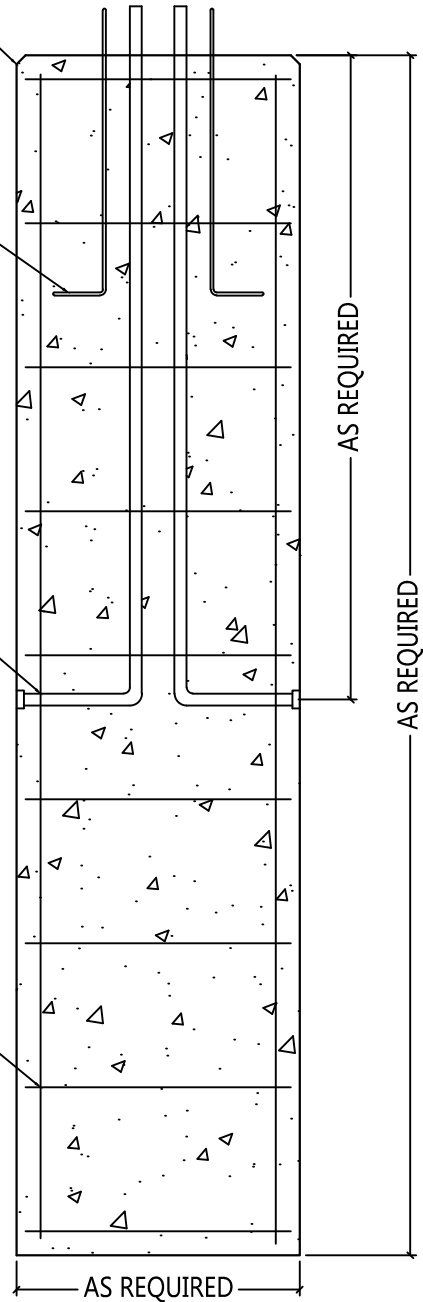

TYPICAL ELEVATION

SPECIFICATIONS:

MINIMUM STRENGTH OF CONCRETE- 4,000 P.S.I. @28 DAYS

AIR ENTRAINMENT- 5 1/2% ± 1 1/2%

STEEL REINFORCEMENT TO MEET CUSTOMER SPECIFICATIONS



Scranton Craftsmen, Inc



930 Dunmore Street

Throop, PA 18512

www.scrantoncraftsmen.com

sales@scrantoncraftsmen.com

Toll Free: 1800- 775-1479

Phone: (570) 347-5125

Fax: (570) 489-4212